

Under the web-address <https://www.process-informatik.de> are product specific documentations or software-driver/-tools available to download.  
If you have questions or suggestions about the product, please don't hesitate to contact us.

Process-Informatik Entwicklungsgesellschaft mbH  
Im Gewerbegebiet 1  
DE-73116 Wäschenbeuren  
+49 (0) 7172-92666-0  
[info@process-informatik.de](mailto:info@process-informatik.de)  
<https://www.process-informatik.de>

**Menutree Website:**

- + Products / docu / downloads
- + Accessories
  - + Connection cable / adapter
  - + USB
    - + USB 2.0 connection cable type A/A




**QR-Code Website:**



Please make sure to update your drivers before using our products.

## Message via SMS (SMSC)



1. Senden einer SMS
2. Weiterleiten auf Handy
3. Aktiver "Weckruf" und Aufforderung zur Quittierung
4. Quittierung

A SMS to a mobile phone is basically send by SMSC. Within the GSM-network it takes place via on-net SMSC. Thereby it's unimportant in which mobile network the receiver is.

The message is activated by:

- digital contacts (relays, motion detector...)
- serial interface (PLC, PC, Microcontroller ...) bitserial (PLC)


The detection system transmits the SMS to the mobile network operator. The mobile network operator provides the SMS to the mobile phone. Optionally the detection system dials the mobile phone to wake up" the receiver or to initiate the confirmation handling.

## Wireless around the machine with LAN-port




Move wirelessly around the machine with LAN-port and communicate for example ONLINE in the status

## Data backup S5-PLC on FTP-server via dig. IO

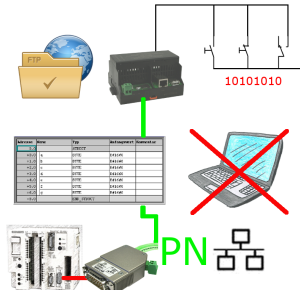


Via digital input triggered DB-backup/-restore without additional PC via PG-socket and Ethernet to FTP-server

## Complete supply from the PC

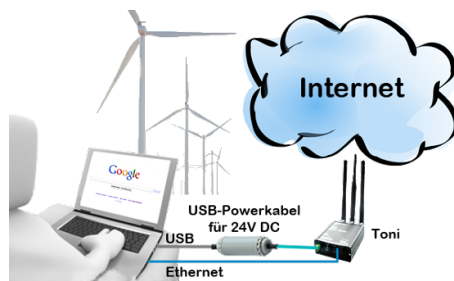

## PLC coupling S5 and S7

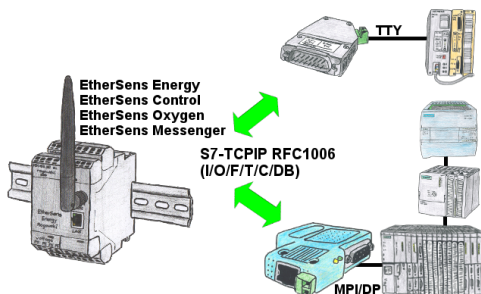

Data-processing/-recording of PLC-data?

Data-logging of recorded process-values in a DB writing or read out in the connected PLC via network, thanks to RFC1006-communication in the devices is nothing in the way.


Even accesses to flags (individual bits of the words) are possible at any time. Configure the data via the integrated web-server that gets target-PLC or returns the necessary-data.

If the PLC does not have an Ethernet-port, with optional adapters, enable this communication:

\* S5 over S5-LAN++

\* S7-PPI/MPI/Profibus over S7-LAN

## Logged data to FTP-server

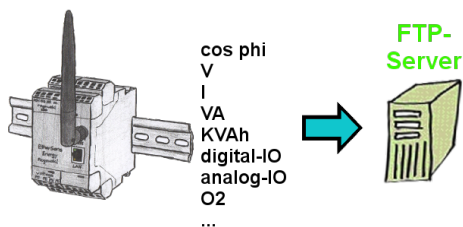

Do you need the logged data not locally but on your site? Then just turn on recording on an FTP-server and the data is stored. You can then immediately read and process this data.