

Under the web-address <https://www.process-informatik.de> are product specific documentations or software-driver/-tools available to download.
If you have questions or suggestions about the product, please don't hesitate to contact us.

Process-Informatik Entwicklungsgesellschaft mbH

Im Gewerbegebiet 1

DE-73116 Wäschenbeuren

+49 (0) 7172-92666-0

info@process-informatik.de

<https://www.process-informatik.de>

Menutree Website:

- + Products / docu / downloads
- + Hardware
 - + PD-interface-multiplexer
 - + PG-MUX-II family
 - + PG-MUX-II for Siemens



QR-Code Website:




Please make sure to update your drivers before using our products.

Wireless around the Bosch-PLC



Move wirelessly around the Bosch-PLC and communicate for example ONLINE in the status

Many PLC-devices conflated

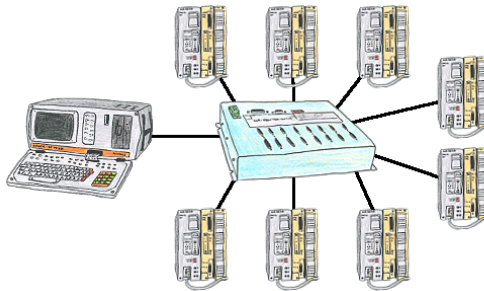

You have many PLC and you want to programm them central on one place? No problem, you have to connect them all to the KOR/MUX-Tele-Switch an with the PD-bus-selection of your Step5-software you go ONLINE. Of course the KOR/MUX-Tele-Switch is cascadable, so you can connect up to 30 PLCs to the devices.

Informations about the bus

S7-LAN V2.63
Kuehlhaus_1
IP:192.168.1.56

- Startseite
- Verbindungen
- Display
- Module
- Konfiguration
- Zugriffsrechte
- Passwort
- Neustart

ID	IP-Adresse	Quali TSNP	Zeit TSNP	CPU	Busstatus	Paralle
1	0
2	0
3	0
4	0
5	0
6	0
7	0
8	0

ID	KnotenID	Empfangen	Senden
1

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19
1																			
2																			
3																			
4																			
5																			
6																			
7																			
8																			
9																			
10																			
11																			
12																			
13																			
14																			
15																			
16																			
17																			
18																			
19																			

■ Station Aktiv ■ Station Aktiv/Ready ■ Station Passiv

Zustand	Busknoten	Empfangen	Senden
...

View information from the connected bus-system in plain text without using the Simatic-Manager or TIA-Portal. With the connection-menu you get the list of reachable nodes, marked in color whether it is an "active bus-participant", is a "candidate for inclusion in the bus" or a "passive bus-participant".

You can also see whether cyclic bus-parameter-protocols have been received, you are "in the bus" yourself, the bus-address of the participant recognized as a "direct participant" (on which the S7-LAN is located) and whether the contained modules such as "variable control", "gateway-coupling",... actively communicate.

Interface-converter with galvanic decoupling

Bis zu / up to
1000V


Sinec L1<=> RS232
TTY<=> RS232
RS422<=> RS232
RS232<=> RS422

Coupling of 2 devices with different hardware-interfaces?

Devices of the UNI-COM-series offer the implementation of different hardware-interfaces with simultaneous galvanic-separation of both sides up to 1000V. Connections to the device via screw-terminals or via the integrated D-Sub with screw-locking. Universally usable for every application.


Only a 24V DC supply is required for the converter.

Remote maintenance / telecontrol of PLC

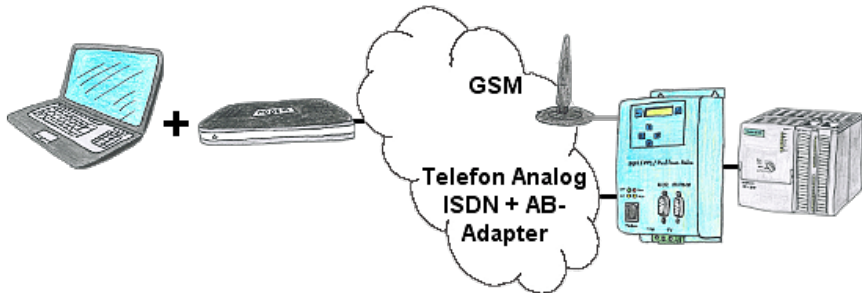

The access to the connected PLC with the Siemens TS-software or PG-2000 including TS-option results of coupling via Analogue-, ISDN- (only with AB-adapter) as well as GSM-line.

Link S7-TCP-IP Panel to MPI Profibus over WiFi

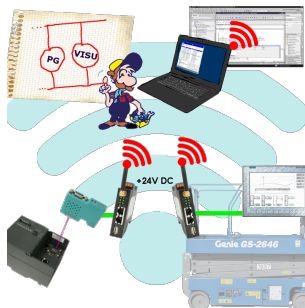

Use the latest S7-TCP-IP panels for your MPI / Profibus.
Thanks to WLAN also usable for mobile platforms or cranes.
Connect several nodes at the same time via a network module.
Simultaneous access from different systems possible.