

Under the web-address <https://www.process-informatik.de> are product specific documentations or software-driver/-tools available to download.
If you have questions or suggestions about the product, please don't hesitate to contact us.

Process-Informatik Entwicklungsgesellschaft mbH

Im Gewerbegebiet 1

DE-73116 Wäschenbeuren

+49 (0) 7172-92666-0

info@process-informatik.de

<https://www.process-informatik.de>

Menutree Website:

- + Products / docu / downloads
- + Hardware
- + Analysis technic
- + Oxygen - Service - Controller II




QR-Code Website:




Please make sure to update your drivers before using our products.

Variable-chart without Step7-programming package

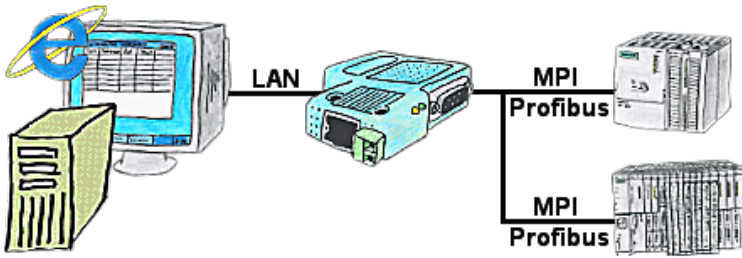


You would like to give your customer the opportunity to read current numbers of the manufacturing Online, without installing a visualisation or even the STEP7-package? Then a S7-LAN with the option Status Variable" is needed, and your customer can take a look at these password protected data on a site of the integrated webserver.

Remote maintenance / telecontrol of PLC

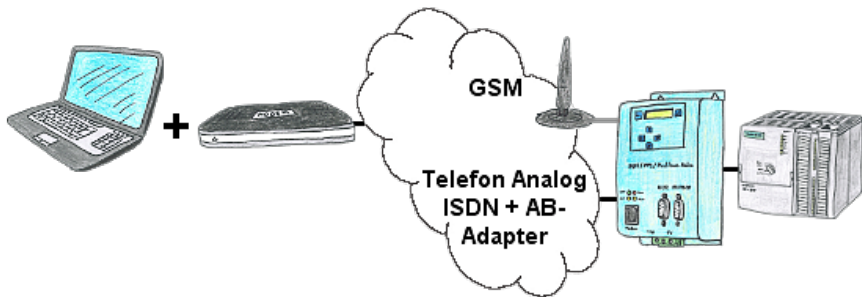


The access to the connected PLC with the Siemens TS-software or PG-2000 including TS-option results of coupling via Analogue-, ISDN- (only with AB-adapter) as well as GSM-line.

PLC coupling (data exchange between PLCs)

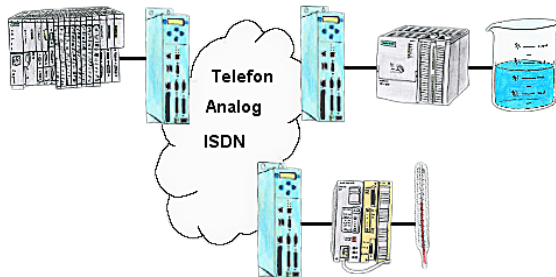


Your pumping stations report the water levels of the central control via telephone network. The central office itself can of course transmit commands/messages to the substations as well. Thereto no dedicated line is required, a "normal" telephone connection is sufficient because the devices cut the line after occurred message.

Current S7 panels via WLAN to the S5 controller

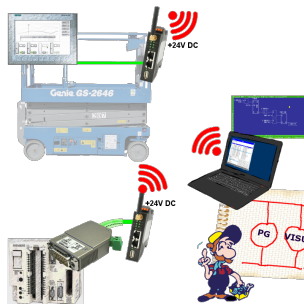

Connect each S7-TCP-IP panel to your S5.
Now also available via WLAN for mobile workstations.
PARALLEL several panels and even simultaneous PG connections possible.
Include hard-to-reach places in your ERP system.

Extend MPI/DP-bus over network or convert to network



MPI/DP communication between two S7-300/400 controllers on the same bus


- a control is relocated spatially:

2x S7-LAN with activated X_PUT/X_GET module, the data is transported between the modules via the network.

- a control is replaced by a PN control:

1x S7-LAN with activated X_PUT/X_GET module and the received-data are transferred automatically to the configured PN-PLC via PUT/GET.

Interface-converter with galvanic decoupling



Coupling of 2 devices with different hardware-interfaces?

Devices of the UNI-COM-series offer the implementation of different hardware-interfaces with simultaneous galvanic-separation of both sides up to 1000V. Connections to the device via screw-terminals or via the integrated D-Sub with screw-locking. Universally usable for every application.

Only a 24V DC supply is required for the converter.