

Under the web-address <https://www.process-informatik.de> are product specific documentations or software-driver/-tools available to download.

If you have questions or suggestions about the product, please don't hesitate to contact us.

Process-Informatik Entwicklungsgesellschaft mbH

Im Gewerbegebiet 1

DE-73116 Wäschenbeuren

+49 (0) 7172-92666-0

info@process-informatik.de

<https://www.process-informatik.de>

Menutree Website:

+ Products / docu / downloads

+ PG-MUX-II for SIEMENS-S5 115V version




QR-Code Website:




Please make sure to update your drivers before using our products.

Data backup S7-PLC over MPI/Profibus on FTP-server via dig. IO

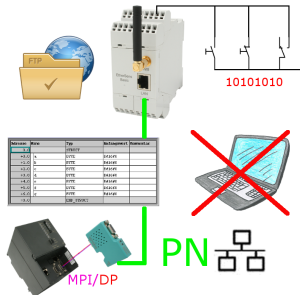


Via digital input triggered DB-backup/-restore without additional PC via MPI/Profibus to FTP-server

DB-Backup/Restore S7-PLC PN-port on USB-stick via dig. IO

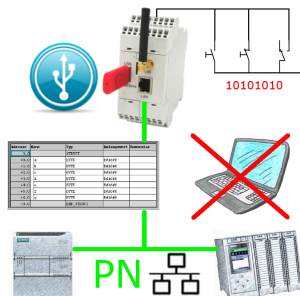


Via digital input triggered DB-backup/-restore without additional PC via PN-port to USB-stick

Standalone recording

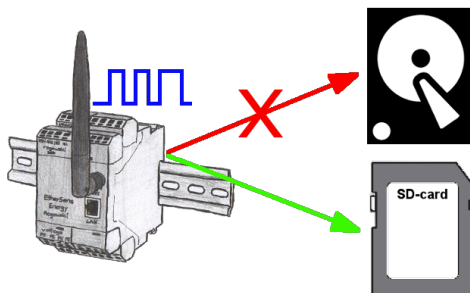

With the integrated SD-card-slot you back-up the recorded data in the device and don't need an external memory. Nevertheless you can send additional the data via FTP to a FTP-server.

Turbo-LAN-interface for the S5

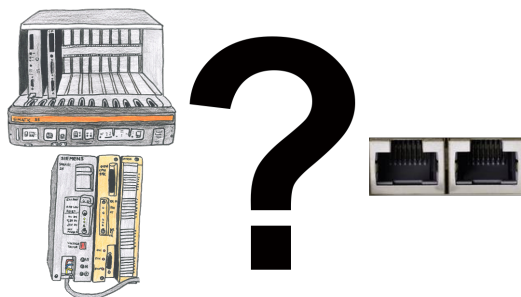


S5-115U/135U/150U/155U and need further processing of data via network and PG interface too slow?

Plug the "S5-TCPIP 100" interface-card into a free slot in the rack, integrate the card into the S5 and nothing stands in the way of communication. Access the controller-data "parallel" to the PG-interface with "Power", regardless of whether it is "TCP/IP" or "ISO on TCP (RFC1006)", "ISO (H1)", "Modbus on TCP" or "SPS header", the interface-card reacts to the various protocols according to your configuration and returns the required data.


With the integrated 4-way-switch, several LAN-participants can be connected to the card and thus to the controller.

S7-300/400 (MPI/DP) to S7-300/400 (MPI/DP)

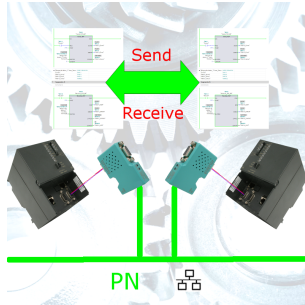

Coupling S7-controller with MPI/Profibus at S7-controller with MPI/Profibus via network

Setting the PLC time

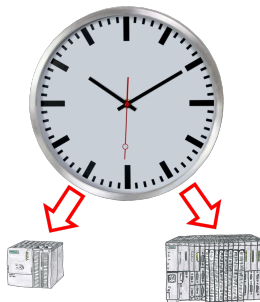

Summer-/winter-time switching, yet this buzzword is one term. Always in March and October the problem of time-change to the PLCs of their plant(s). Capture the controllers in the "S7-PLC exact time synchronization"-tool and automates setting the time in the controllers.

No change on the PLC-program necessary!

Whether MPI/Profibus via S7-LAN or Profinet!