

Step5/7-Programming system PG-2000

Installation note:

Load your license file using the link given in your personal license email.
The password for extraction can also be found in this email. Then copy this file into the folder of the installed PG-2000 software (demo version).
After restarting the software, your license is active.


Under the web-address <https://www.process-informatik.de> are product specific documentations or software-driver/-tools available to download.
If you have questions or suggestions about the product, please don't hesitate to contact us.

Process-Informatik Entwicklungsgesellschaft mbH
Im Gewerbegebiet 1
DE-73116 Wäschenbeuren
+49 (0) 7172-92666-0
info@process-informatik.de
<https://www.process-informatik.de>

Menutree Website:


- + Products / docu / downloads
- + PG-2000 S5/7-LAD-extension

QR-Code Website:




Please make sure to update your drivers before using our products.

Logged data to Excel

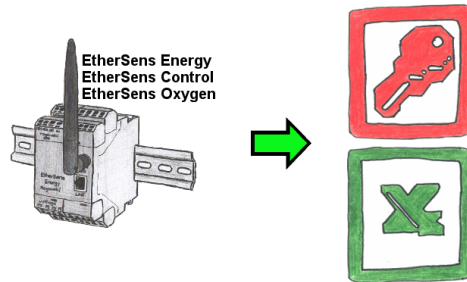


Capture the required values, whether if energy-data, states of inputs or outputs, process values such as oxygen-content in the environment,... and write this with a timestamp in a CSV-file. This file can then be read and processed with Excel.

Connect MPI / Profibus with current network panels

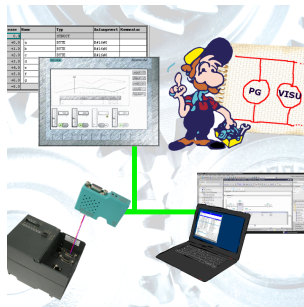


Visualize with the latest S7 network panels directly on your MPI Profibus.
No PLC change necessary.
Connect several nodes at the same time via a network module.
Simultaneous access from different systems possible.

PLC coupling (data exchange between PLCs)

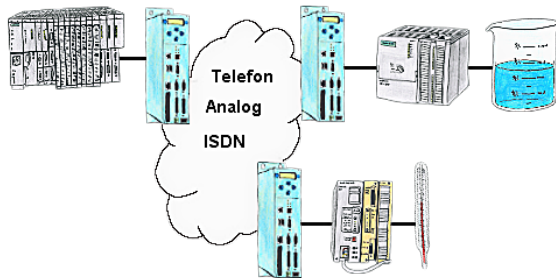


Your pumping stations report the water levels of the central control via telephone network. The central office itself can of course transmit commands/messages to the substations as well. Thereto no dedicated line is required, a "normal" telephone connection is sufficient because the devices cut the line after occurred message.

Data backup S7-PLC PN-port on USB-stick




S7-PLC triggered DB-backup/-restore without additional PC via PN-port to USB-stick

Remote maintenance / telecontrol of PLC-devices

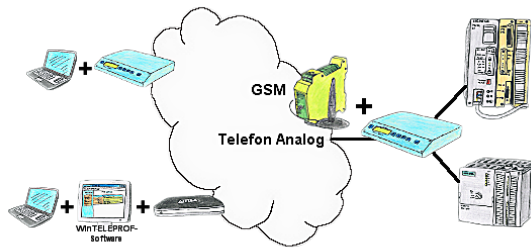

Access to the connected PLC takes place by coupling via Analogue-, ISDN- (only with AB-adapter) and GSM-(only with external GSM-modem)-line.

Interface for Mitsubishi Melsec Fx- & A-series

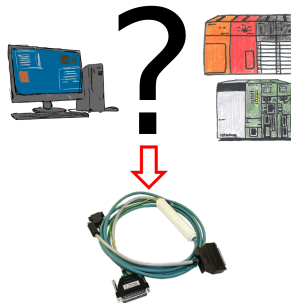

Changes to Mitsubishi PLCs but no interface cable?

Use the SC09 cable to connect the PC to the Mitsubishi MELSEC FX & A series. Any PLC with an RS-422 interface can be connected. Including adapter cable for 8-pin DIN connection, firmly attached so that it can never be forgotten. One cable for both types, universal to the Mitsubishi PLC.