

Under the web-address <https://www.process-informatik.de> are product specific documentations or software-driver/-tools available to download.  
If you have questions or suggestions about the product, please don't hesitate to contact us.

Process-Informatik Entwicklungsgesellschaft mbH

Im Gewerbegebiet 1

DE-73116 Wäschenbeuren

+49 (0) 7172-92666-0

[info@process-informatik.de](mailto:info@process-informatik.de)

<https://www.process-informatik.de>

**Menutree Website:**

- + Products / docu / downloads
- + Hardware
  - + PD-interface-multiplexer
  - + PG-MUX-II family
  - + PG-MUX-II for Siemens




**QR-Code Website:**




Please make sure to update your drivers before using our products.

## Data acquisition/logging

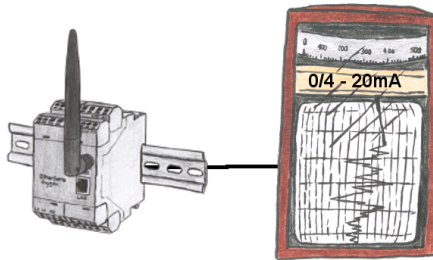


By connecting a line-recorder to the EtherSens-device anyone without network-knowledge can visually capture and further process the log.

## Atomic time (GPRS) for the PLC

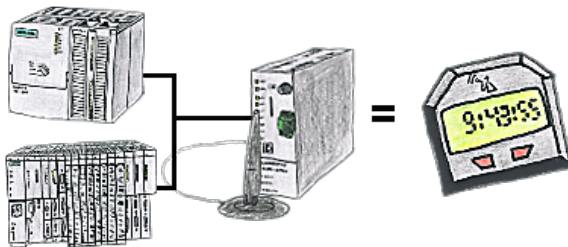


You need an exact time for your S7-plc? No problem, the TeleService-GSM fetches the current time via GPRS from a time-server and advises it to the S7-plc. How often and whenever the time shall be updated can be parameterised in the device.

## Data backup S5-PLC on FTP-server via dig. IO




Via digital input triggered DB-backup/-restore without additional PC via PG-socket and Ethernet to FTP-server

## PLC-coupling (data exchange between PLC-devices)

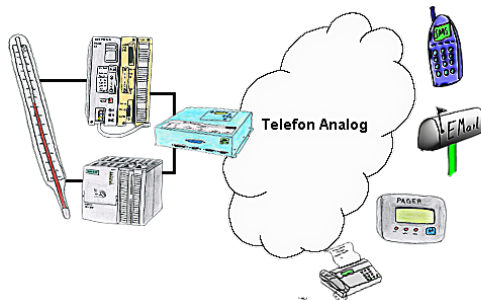


Your outstation reports the current value cyclically, or in case of malfunction the status via FAX, to your mobile phone as SMS or to your pager.

## Serial programming of the S7- PLC

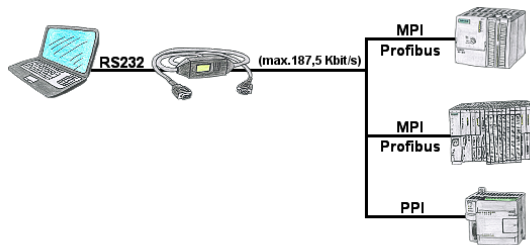

With the MPI/PPI-cable you have the ability to access a connected SPC-PLC S7-200 (PPI 9600 Baud and 19200 Baud) as well as S7-300/400 (MPI/Profbus 9600 Baud up to 187500 Baud) via PC serial with up to 115200 Baud for reading respectively writing of data.

## S5 to S5

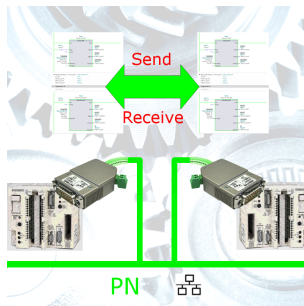

Coupling S5-controller with PD-port at S5-controller with PD-port via network