

Under the web-address <https://www.process-informatik.de> are product specific documentations or software-driver/-tools available to download.
If you have questions or suggestions about the product, please don't hesitate to contact us.

Process-Informatik Entwicklungsgesellschaft mbH

Im Gewerbegebiet 1

DE-73116 Wäschenbeuren

+49 (0) 7172-92666-0

info@process-informatik.de

<https://www.process-informatik.de>

Menutree Website:


- + Products / docu / downloads
- + Hardware
- + PD-interface-multiplexer
- + T-Connector to PPI/MPI-Bus

QR-Code Website:




Please make sure to update your drivers before using our products.

Data backup S5-PLC on FTP-Server




S5-PLC triggered DB-backup/-restore without additional PC via PG-socket and Ethernet on FTP-server

Failure report transmission without any change in the PLC program

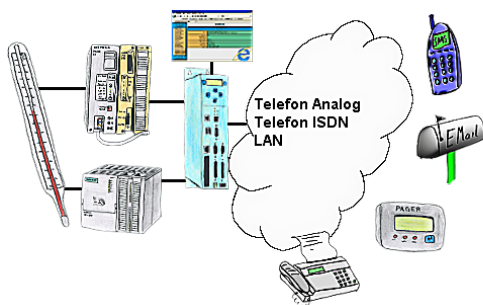


Your outstation reports the current value cyclically, or in case of malfunction the status via FAX, as SMS to your mobile phone, to your pager or also via e-mail. And this without an intervention of the PLC-program. Here the variables and actions are stored and processed in the TP-II.

Process energy-data with LOGO!

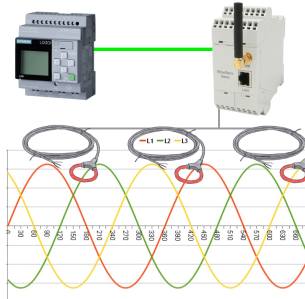


Process of all kinds of the recorded energy-values with the LOGO!-Control

Remote maintenance of a S7-PLC[FREWARE without support]

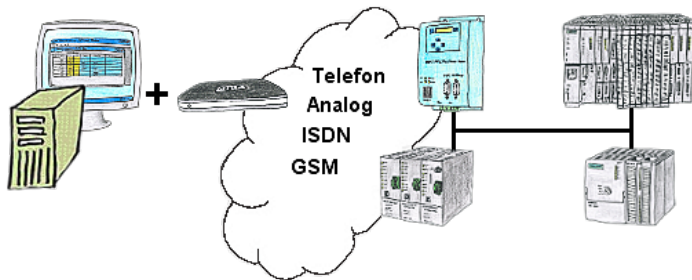

You have to solve a problem in the PLC-program, but the installation is not placed nearby? No problem, start your PG-2000-software with "option teleservice", activate your modem and after selection intra PG-2000-software access to the PLC is possible as if being on-site.

Passive PoE

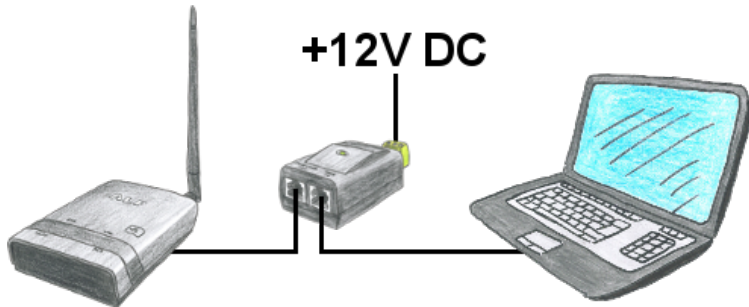

You don't want to power ALF with 24V DC because you have in your network PoE "Power over Ethernet" in use. No problem, ALS provides passive PoE, this means he can be powered with the not used cables of the lan-cable with 12V DC. You don't need additional the 24V DC.

Attention: Don't connect a PoE-cable to a lan-client which doesn't provide PoE! The device could be damaged!

Detect failure of Profinet-devices



Identify devices that are likely to fail in the near future.
Detect defective devices that no longer respond to PN protocols.
Defective devices are reported by email and logged.
No long troubleshooting thanks to exact station information.